



CONCRETE GUTTER
TYPE A

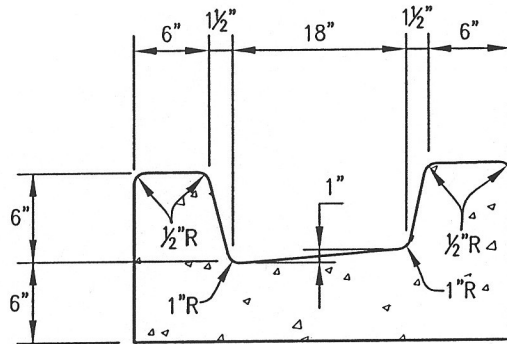

CONCRETE "U" GUTTER
TYPE B

NOTES:

1. Concrete shall be of class 520-C-2500.
2. All gutter flowlines shall be water tested.
3. Weakened-plane joints shall be constructed at 12' intervals except through driveway and alley aprons.



9-16-04
DATE APPROVED

[Signature]
PUBLIC WORKS DIRECTOR/C.E.
[Signature]
ASSISTANT CITY ENGINEER

CITY OF ORANGE PUBLIC WORKS DEPARTMENT

STANDARD CONCRETE GUTTERS
FOR ON SITE PARKING LOTS

STANDARD
PLAN No.
127